

Microcluster

General installation process

Thank you for buying a Firewallhardware system. The following information will help you rack-mount the firewall system.


This guide and other supporting documents are located on the web at:
<http://www.firewallhardware.it/en/microcluster.html>



FIREWALLHARDWARE.IT

MCL1NJ5R1-12 / MCL2NJ5I1-12

System Features and Components

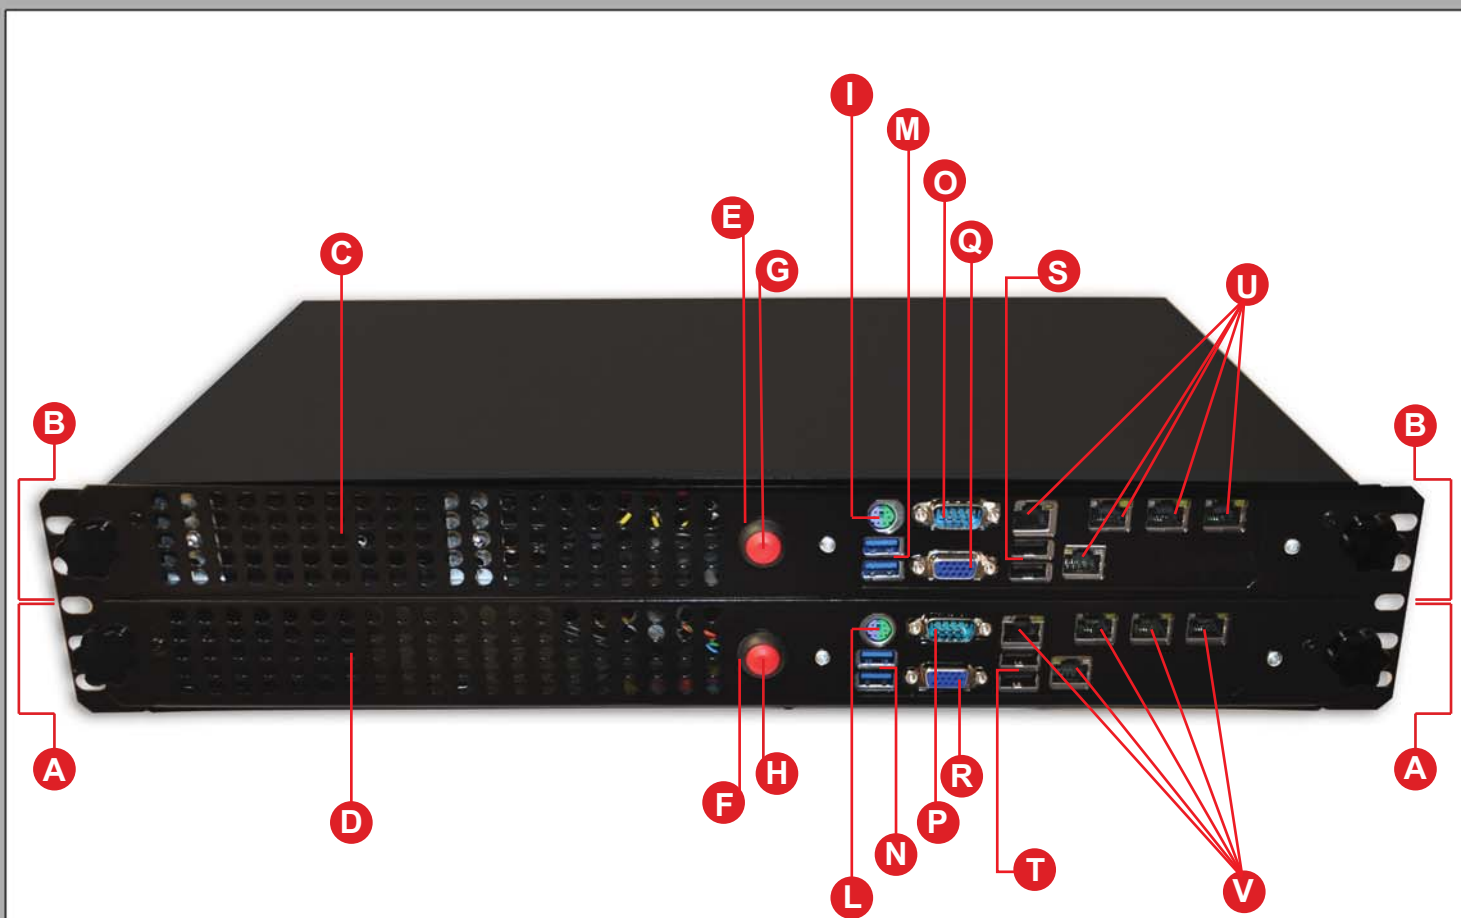

- A** System 1
- B** System 2
- C** Cooling Tunnel System 2
- D** Cooling Tunnel System 1
- E** Power Button System 2
- F** Power Button System 1
- G** Power Activity Led System 2
- H** Power Activity Led System 1
- I** Keyboard /Mouse PS2 System 2
- L** Keyboard /Mouse PS2 System 1
- M** USB System 2
- N** USB System 1
- O** Serial Port System 2
- P** Serial Port System 1
- Q** VGA System 2
- R** VGA System 1
- S** USB System 2
- T** USB System 1
- U** NIC - Network Interface Card System 2
- V** NIC - Network Interface Card System 1

Rack Mount Instructions

1

Preparing the System



The system must be completely disconnected from any cable.

2

Remove Screws



Unscrew the 4 screws on the front panel.

3


Remove both drawers



Remove both drawers.

4

Rack Mount

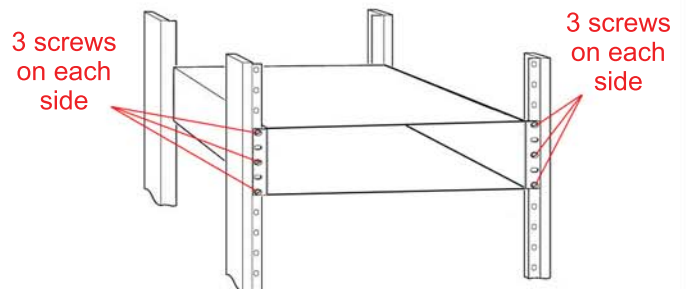

Arm the system without the drawers in the rack cabinet. Use 3 screws on each side.

5

Power cables



Insert the 2 power cables through the rack-mounted system.

6

Reinsert System 1



Reinsert the bottom drawer (System 1). Tighten 2 screws to secure it to the rack system.

7

Reinsert System 2



Repeat Step 5 and Step 6
for System 2.